

CREEK COUNTY RURAL WATER DISTRICT 2 – SAPULPA CUSTOMERS

IMPORTANT INFORMATION ABOUT YOUR DRINKING WATER

Our water system recently violated drinking water standards. Although this was not an emergency, as our customers, you have a right to know what happened, what you should do, and what we are doing to correct this situation.

Creek County Rural Water District 2 has levels of Total Trihalomethanes (TTHMs) above drinking water standards.

We routinely monitor for the presence of drinking water contaminants. Testing results we received for indicated time periods show that our system exceeds the standard, or Maximum Contaminant Level (MCL) for Total Trihalomethanes (TTHMs). The standard or MCL for TTHMs is 0.080 mg/l. It is determined by averaging all the samples collected at each sampling location for the past 12 months. The level of TTHMs averaged at our system's location was the following:

<u>MONITORING LOCATION:</u>	<u>TWELVE-MONTH TIME PERIOD:</u>	<u>LOCATIONAL RUNNING ANNUAL AVERAGE:</u>
TTHM_02-2950 Dogwood Sapulpa, OK	Third Quarter 2022	Average 0.099 mg/l

What should I do? There is nothing you need to do unless you have a severely compromised immune system, have an infant or are elderly. These people may be at increased risk and should seek advice about drinking water from their health care providers.

What does this mean? This is not an emergency. If it had been, you would have been notified immediately. Some people who drink water containing trihalomethanes in excess of the maximum contaminant levels over many years, may experience problems with their liver, kidneys or central nervous system, and may have an increased risk of getting cancer.


CORRECTIVE ACTION:

What happened? What is being done? When will the violation be resolved?

The latest Stage II testing revealed the disinfection by-products in our water were 99 parts per billion (ppb). There is no immediate risk from the water with TTHMs above 80 ppb. We are flushing our water lines and will test for TTHMs monthly to monitor the situation and are working closely with our supplier to make any needed adjustments.

For further information contact:

District Manager, Cindy Hubbell



918-299-4448 2425 W. 121st St. So. Jenks, OK. 74037


Please share this information with all the other people who drink this water, especially those who may not have received this notice directly (for example, people in apartments, nursing homes, schools, and businesses). You can do this by posting this notice in a public place or distributing copies by hand or mail.

This notice is being sent to you by Creek County Rural Water District 2

PWSID# OK3001902

NOV# P-3001902-22-1

Date Distributed: January 19, 2023

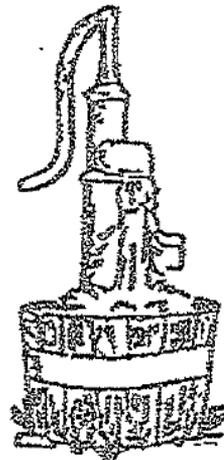

CREEK COUNTY RURAL WATER DISTRICT 2 – SAPULPA CUSTOMERS

IMPORTANT INFORMATION ABOUT YOUR DRINKING WATER

Our water system recently violated drinking water standards. Although this was not an emergency, as our customers, you have a right to know what happened, what you should do, and what we are doing to correct this situation.

Creek County Rural Water District 2 has levels of Total Trihalomethanes (TTHMs) above drinking water standards.

We routinely monitor for the presence of drinking water contaminants. Testing results we received for indicated time periods show that our system exceeds the standard, or Maximum Contaminant Level (MCL) for Total Trihalomethanes (TTHMs). The standard or MCL for TTHMs is 0.080 mg/l. It is determined by averaging all the samples collected at each sampling location for the past 12 months. The level of TTHMs averaged at our system’s location was the following:

<u>MONITORING LOCATION:</u>	<u>TWELVE-MONTH TIME PERIOD:</u>	<u>LOCATIONAL RUNNING ANNUAL AVERAGE:</u>
TTHM_02-2950 Dogwood Sapulpa, OK	Third Quarter 2021 through Second Quarter 2022	Average 0.084 mg/l

What should I do? There is nothing you need to do unless you have a severely compromised immune system, have an infant or are elderly. These people may be at increased risk and should seek advice about drinking water from their health care providers.

What does this mean? This is not an emergency. If it had been, you would have been notified immediately. Some people who drink water containing trihalomethanes in excess of the maximum contaminant levels over many years, may experience problems with their liver, kidneys or central nervous system, and may have an increased risk of getting cancer.

CORRECTIVE ACTION:

What happened? What is being done? When will the violation be resolved?

The latest Stage II testing revealed the disinfection by-products in our water were 84 parts per billion (ppb). There is no immediate risk from the water with TTHMs above 80 ppb. We are flushing our water lines and will test for TTHMs monthly to monitor the situation and are working closely with our supplier to make any needed adjustments.

For further information contact:

District Manager, Cindy Hubbell Cindy Hubbell 918-299-4448 2425 W. 121st St. So. Jenks, OK. 74037

Please share this information with all the other people who drink this water, especially those who may not have received this notice directly (for example, people in apartments, nursing homes, schools, and businesses). You can do this by posting this notice in a public place or distributing copies by hand or mail.

This notice is being sent to you by Creek County Rural Water District 2

PWSID# OK3001902 NOV# P-3001902-22-1

Date Distributed: 10/18/2022

